

GOVERNMENT OF TELANGANA
OFFICE OF THE DISTRICT MEDICAL & HEALTH OFFICER, KARIMNAGAR
Rc. No. 1010/DM&HO/HE/2026
SC.No. /2026



Date: 31.01.2026.

**AS PER APPENDIX – 14
(RWE – 84 CHAPTER II)**


**SANITARY CERTIFICATE FOR THE PURPOSE OF THE
RECOGNITION/RENEWAL**


The District Health Educator, Karimnagar, has inspected the **PARAMITA WORLD SCHOOL, H.NO. 5-13/5/1, ALUGUNUR, KARIMNAGAR** and certified that the accommodation provided for each of the several classes is sufficient for the maximum number of pupil through there in and is properly ventilated and the building is maintained in substantial repairs that is neat and clean the latrine arrangements are adequate and satisfactory.


The support of "Sanitation, Ventilation and Good Drinking Water" facilities in the School is provided and that in all other necessary respects the sanitation is good.

Station: Karimnagar
Date: 21.01.2026.




District Medical and Health Officer,
KARIMNAGAR.

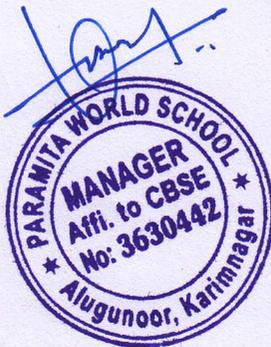


Principal
PARAMITA World School
Affiliated to the CBSE # 3630442
Alugunoor, Karimnagar.



GOVERNMENT OF TELANGANA
REGIONAL PUBLIC HEALTH LABORATORY, WARANGAL
 HANAMKONDA (KUDA Premises) - 506 001.
 Report of Physical, Chemical Analysis of Water &
 Chemical Analysis of Water for Construction Purpose*

Sample from : *The Principal, Paramitha World School,*
 Collected by : *Selt - 11.10.15/11/Alugunoor* Paid/Free :
 Collected on : *18/12/2015 Dist - Karimnagar* Receipt No. : *7838*
 Received on : Amount : *230.00*

Lab Ref. No. :	2130	IS10500:2012
Address of Sources :	R.O. plant theater School	Acceptable limit Permissible limits in the absence of alternate source
Substance or Characteristic :		
Colour :	15	5 15
Odour :	Agreeable	Agreeable Agreeable
Turbidity NTU :	-	1 5
*P ^H at °C :	6.7	6.5 - 8.5 No relaxation
Electrical conductivity (at 25° C Micro Mhos /cm) :	93	
* Total Dissolved Solids (mg/Lt.) :	60	500 2000
<i>The following results are in mg/liter</i>		
Phenolphthalein Alkalinity :	NIL	
Total Alkalinity (as CaCO ₃) :	18	200 600
Total hardness (as CaCO ₃) :	10	200 600
Calcium hardness (as CaCO ₃) :	5	
Magnesium hardness (as CaCO ₃) :	5	
Sulphate (as SO ₄ ²⁻) :	-	200 400
Nitrite (as NO ₂) :	NIL	
Nitrate (as NO ₃) :	-	10 No relaxation
*Chloride (as Cl) :	15	250 1000
Fluoride (as F) :	0.05	1.0 1.5
Iron (as Fe) :	-	0.3 No relaxation
*To neutralize 100 ml of water sample using phenolphthalein indicator with 0.02N Na OH (in ml) :		Not more than 5 ml as per is 456 (2000) (Reaffirmed 2005)
*To neutralize 100 ml of water sample using Mixed indicator with 0.02N H ₂ SO ₄ (in ml) :		Not more than 25 ml as per is 456 (2000) (Reaffirmed 2005)

The Given water Sample is physico-chemically Satisfactory for Drinking Purpose.

S. Subrahmanyam
 Senior Analyst

M. Vamsidhar
 Civil Surgeon Bacteriologist I/C



M. Sankar
 Principal
PARAMITA World School
 Affiliated to the CBSE # 3630442
 Alugunoor, Karimnagar.